

Job Name _____

Contractor _____

Job Location _____

Approval _____

Engineer _____

Contractor's P.O. No. _____

Approval _____

Representative _____

LEAD FREE*

Series IBR In-Building Risers Customizable

Sizes: 4" – 10"

Series IBR In-Building Risers are used to connect the main fire supply to the building overhead fire system. The fitting passes under the foundation without joints and extends up through the floor. Provided with installation tabs, the unit has a CIPS (Cast Iron Pipe Size) coupler for easy connection to the underground supply (AWWA C900 PVC and Ductile Iron Pipe) and industry standard grooved-end connection (AWWA C606) on the building side for easy connection to the overhead fire sprinkler system. The IBR features Lead Free* construction to comply with Lead Free* installation requirements.


Ames In-Building Risers are precision engineered and manufactured to provide exceptional reliability and reduce installation time & labor costs associated with field assembly. In accordance with NFPA 24, the UL/FM approved In-Building Risers replace numerous fittings, elbows & spools and reduces the possibility of leaks or failure in comparison to traditional installation methods and materials. Factory tested integrity ensures the highest quality installation. The use of stainless steel significantly increases the reliability and life of the riser.

Features

- Cost savings
- Corrosion resistant stainless steel construction, type 304
- Ease of installation and light weight allows one person to position and handle the riser
- Minimal site preparation; joint restraint one-piece construction reduces time and labor; no missing parts, no leaks; easily identifiable for approvals
- Includes Test Cap and Coupler
- UL/FM approved
- Sizes: available in 4" – 10" with various lengths to meet local requirements
- Designed to meet NFPA 24
- AWWA C900 Inlet/DIP
- AWWA C606 Outlet



6'x6' standard length
(custom lengths from 3' – 20' available)

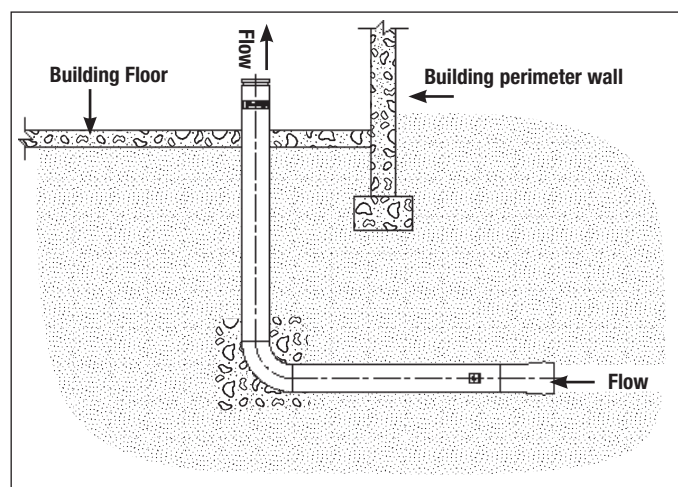

*The wetted surface of this product contacted by consumable water contains less than 0.25% of lead by weight.

Ames Fire & Waterworks product specifications in U.S. customary units and metric are approximate and are provided for reference only. For precise measurements, please contact Ames Fire & Waterworks Technical Service. Ames Fire & Waterworks reserves the right to change or modify product design, construction, specifications, or materials without prior notice and without incurring any obligation to make such changes and modifications on Ames Fire & Waterworks products previously or subsequently sold.

AMES
FIRE & WATERWORKS
A WATTS Brand

Specifications


In-Building Riser shall be installed as indicated on the plans. Riser shall be composed of a single extended 90 degree fitting of fabricated 304 stainless steel tubing, maximum working pressure 200psi (14 bar). The fitting shall have a grooved-end connection on the outlet (building) side and a CIPS coupler on the inlet (underground) side. The grooved end shall include a coupler and cap to facilitate testing of the underground piping. The In-Building Riser shall be an Ames Fire & Waterworks Series IBR.

Approvals

Fittings FM class 1920
UL HKQA (4"-10")



Dimensions – Weights

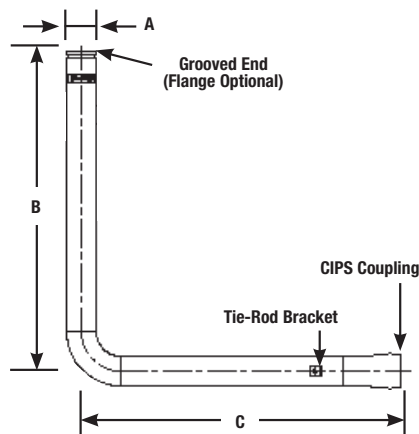

SIZE				WEIGHT			
	A (OD)		B		C		
in.	in.	mm	ft.	cm	ft.	cm	lbs. kg
4	4½	114	6	183	6	183	71 32
4	4½	114	8'-6"	183	6	183	85 39
4	4½	114	9	274	6	183	88 40
4	4½	114	5	152	7	213	71 32
6	6½	168	6	183	6	183	98 44
6	6½	168	8'-6"	259	6	183	122 56
6	6½	168	9	274	6	183	127 58
6	6½	168	5	152	7	213	98 44
8	8½	219	6	183	6	183	129 59
8	8½	219	8'-6"	259	6	183	163 74
8	8½	219	9	274	6	183	170 77
8	8½	219	5	152	7	213	129 59
10	10¾	273	6	183	6	183	202 92
10	10¾	273	9	274	6	183	258 117
10	10¾	273	5	152	7	213	202 92

**Each B (vertical) and C (horizontal) leg is customizable from 3' to 20' with UL/FM approvals. Consult with your factory representative for details.

Standards

NFPA — Designed to allow the contractor to conform to NFPA 24

Where a riser is close to building foundations, underground fittings of proper design and type shall be used to avoid pipe joints being located under the foundations.

End Connections

Horizontal End: Mates with Ductile Iron Pipe and AWWA C900 Pipe (PVC Pipe with Ductile Iron Pipe Equivalent OD's)

Utilizes Gasket conforming to UL 157 with "Lock in" gasket configuration

SIZE	MATING PIPE OD	
	in.	mm
4	4.8	122
6	6.9	175
8	9.1	230
10	11.1	282

Vertical End:

Meets AWWA C-606 dimensions for roll grooved pipe
Meets AWWA C-207 class D for flanges

Ratings

Meets AWWA C-900 pressure class 200, DR 14 Pipe

Testing

Welds are 100% leak tested at the factory

NOTICE

Inquire with governing authorities for local installation requirements

NOTICE

The information contained herein is not intended to replace the full product installation and safety information available or the experience of a trained product installer. You are required to thoroughly read all installation instructions and product safety information before beginning the installation of this product.



A WATTS Brand

USA: Backflow Tel: (978) 689-6066 • Fax: (978) 975-8350 • AmesFireWater.com
USA: Control Valves Tel: (713) 943-0688 • Fax: (713) 944-9445 • AmesFireWater.com
Canada: Tel: (905) 332-4090 • Fax: (905) 332-7068 • AmesFireWater.ca
Latin America: Tel: (52) 55-4122-0138 • AmesFireWater.com