



SIDE VIEW

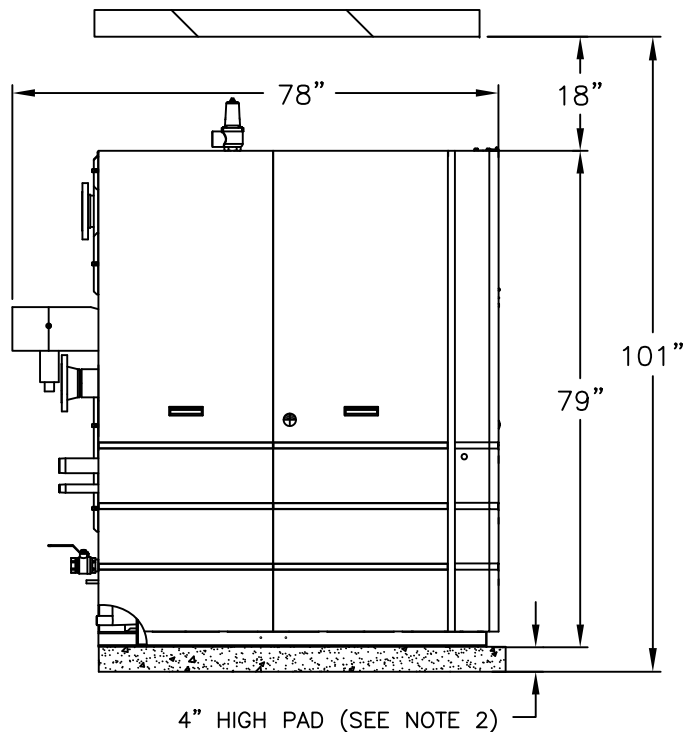

TOP VIEW

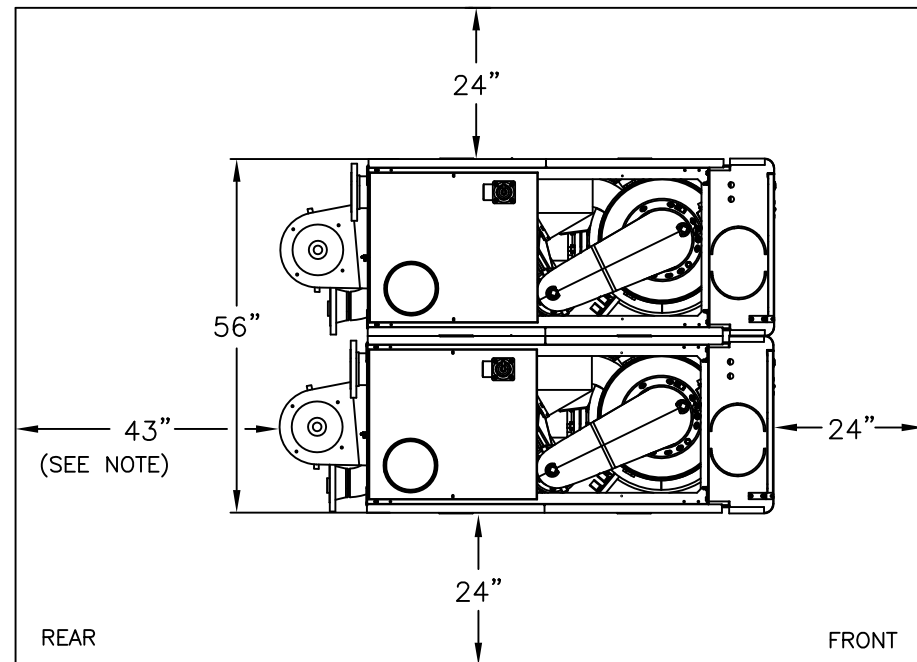

INSTALLATION CLEARANCES

- 1) THIS APPLIANCE MAY BE INSTALLED ON COMBUSTIBLE FLOORING
- 2) MINIMUM CLEARANCES TO ADJACENT CONSTRUCTION ARE AS FOLLOWS:
 LEFT AND RIGHT SIDES: 24"
 FRONT: 24"
 REAR: 43" (SEE NOTE)
 CEILING HEIGHT: 101"
- 3) THE INNER SIDE PANELS MUST BE REMOVED FROM BOTH UNITS FOR ZERO SIDE CLEARANCE INSTALLATIONS
- 4) THE ZERO SIDE CLEARANCE OPTION CAN ONLY BE EMPLOYED IN TWO UNIT SETS

NOTES:

1. REAR CLEARANCE MAY BE REDUCED TO 24" DEPENDENT UPON PIPING AND VENTING COMPONENT SELECTION, ARRANGEMENT, AND LOCAL CODE REQUIREMENTS. HOWEVER, WHEN USING A REAR CLEARANCE OF LESS THAN 43", A 57" FRONT CLEARANCE WILL BE NEEDED TO ALLOW THE REMOVAL OF EXHAUST CONNECTING MANIFOLD.
2. WHEN USING THE AERCO CONDENSATE NEUTRALIZER TANK, FOR PROPER CONDENSATE DRAINAGE, THE NEUTRALIZER TANK MUST BE INSTALLED IN A PIT OR THE BOILER AND THE AERCO CONDENSATE TRAP MUST BE ELEVATED HIGHER THAN 4" ABOVE THE FLOOR. SEE CONDENSATE TANK INSTRUCTIONS TID-0074 FOR DETAILS.

AERCO INTERNATIONAL, INC.
NORTHVALE, NJ 07647

BENCHMARK 3 MIL. BTU LOW NOx
GAS FIRED BOILER
ZERO SIDE CLEARANCE INSTALLATION

DWN. BY GS DATE 061506
SCALE _____
APPD. MC DATE _____

SD-A-683

REV.
D