
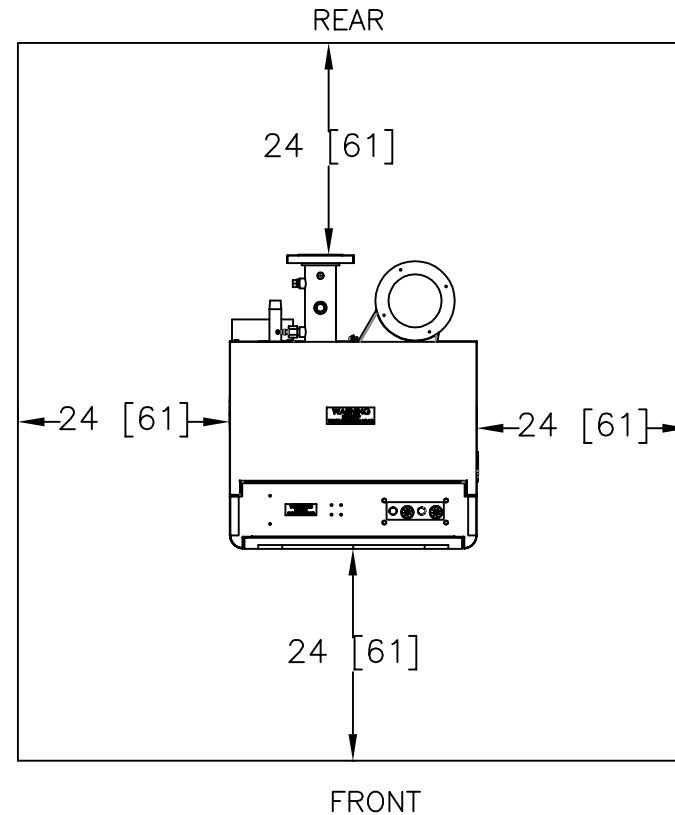


SIDE VIEW

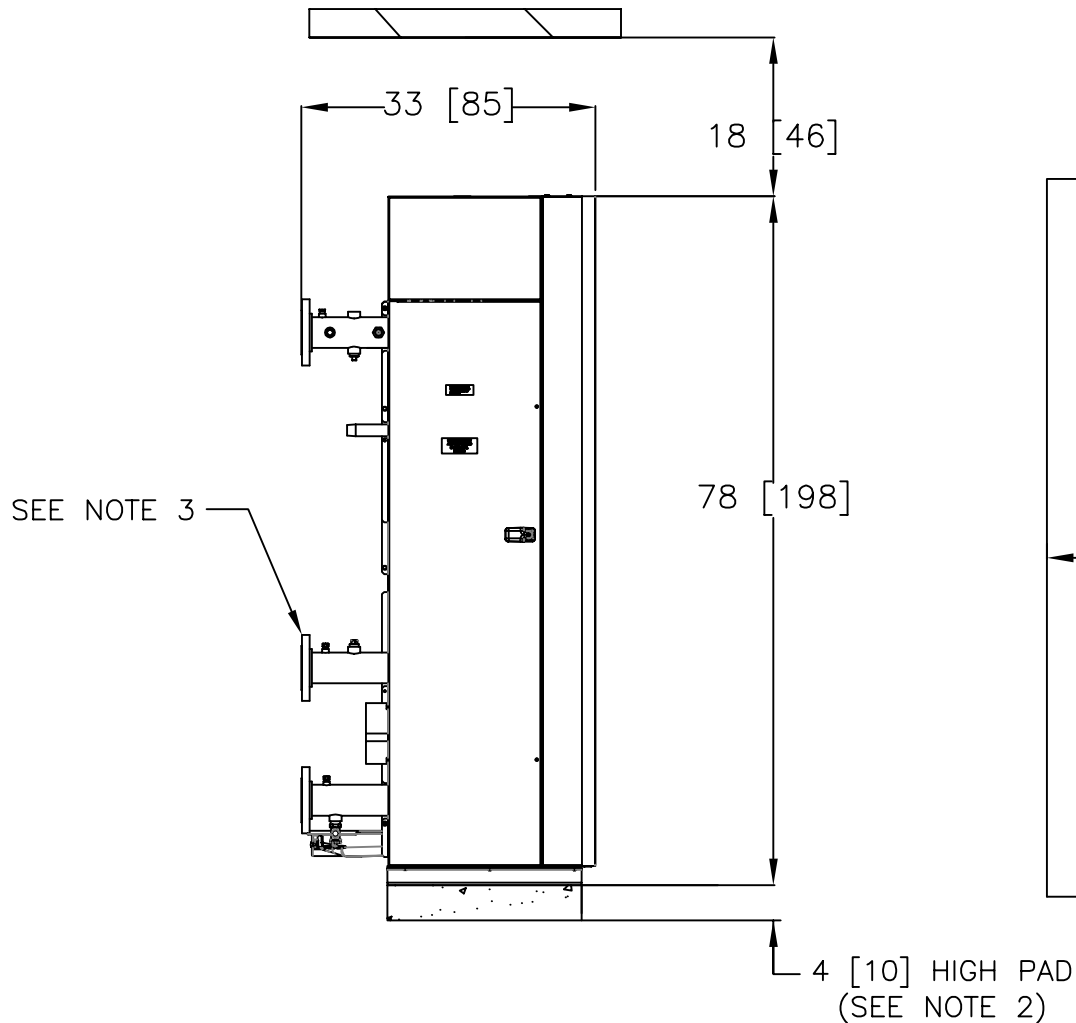

INSTALLATION CLEARANCES:

- 1) THIS APPLIANCE MAY BE INSTALLED ON COMBUSTIBLE FLOORING
- 2) MINIMUM CLEARANCES TO ADJACENT CONSTRUCTION ARE AS FOLLOWS:

LEFT & RIGHT SIDES: 24"  
 FRONT: 24"  
 REAR: 24"  
 CEILING HEIGHT: 100"

NOTE:

1. ALL DIMENSIONS SHOWN ARE IN INCHES (CENTIMETERS).
2. WHEN USING THE AERCO CONDENSATE NEUTRALIZER TANK, FOR PROPER CONDENSATE DRAINAGE, THE NEUTRALIZER TANK MUST BE INSTALLED IN A PIT OR THE BOILER AND THE AERCO CONDENSATE TRAP MUST BE ELEVATED 4" OR HIGHER ABOVE THE FLOOR. SEE CONDENSATE TANK INSTRUCTIONS TID-0074 FOR DETAILS.
3. SECONDARY INLET ONLY AVAILABLE ON BENCHMARK® PLATINUM SERIES UNITS.
4. CLEARANCE DIMENSIONS ARE MINIMUMS RECOMMENDED BY AERCO. LOCAL CODES AND AUTHORITIES SHOULD BE CONSULTED.

AERCO RESERVES THE RIGHT TO MODIFY BOILER DIMENSIONS WITHOUT PRIOR NOTICE

<b>AERCO</b> <small>A WAITS Brand</small>		<small>100 ORITANI DRIVE BLAUVELT, NY 10913 aerco.com</small>
<b>BENCHMARK 750 &amp; 1000 MBH GAS FIRED BOILER SINGLE UNIT CLEARANCE DRAWING</b>		
DWN. BY <u>    </u> PDR DATE <u>051011</u>	SCALE <u>    </u>	REV <u>    </u>
APPD. <u>    </u> DATE <u>    </u>	SD-A-871	C