



SIDE VIEW

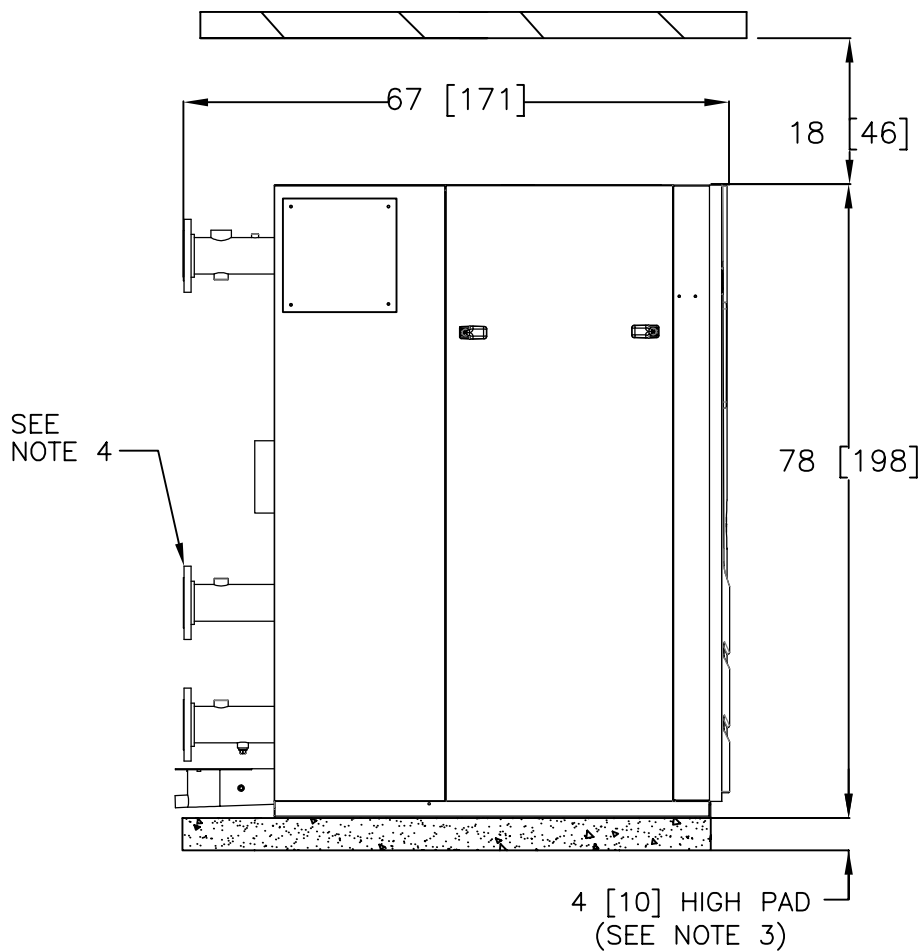

REAR

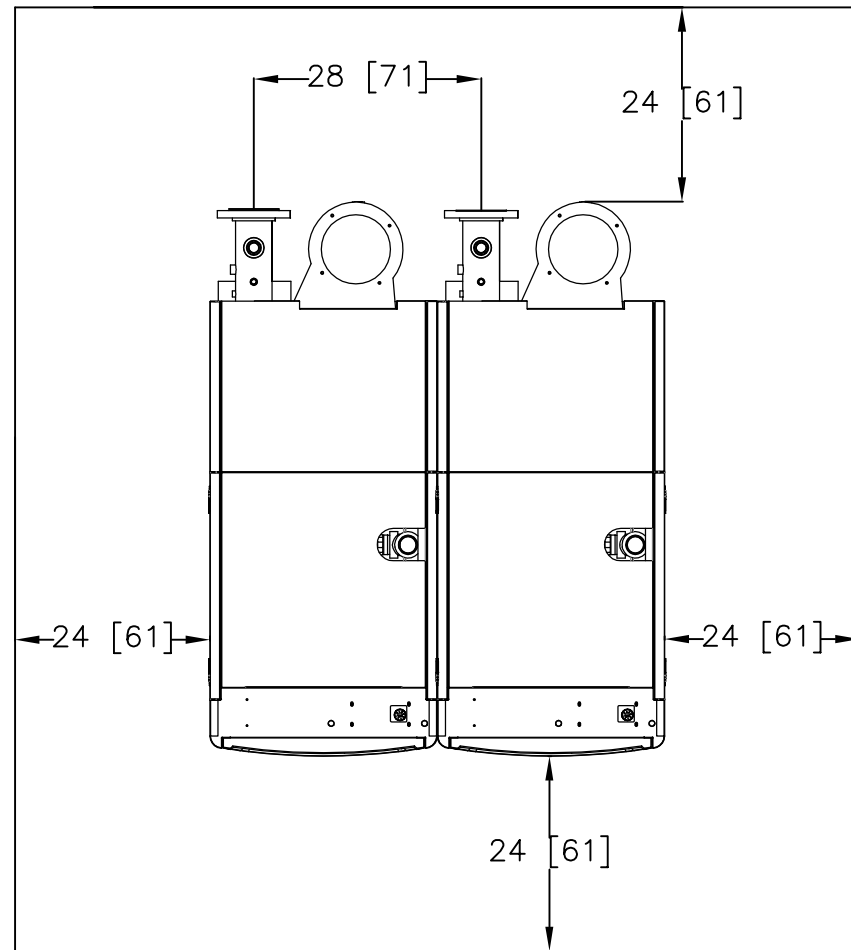

FRONT

INSTALLATION CLEARANCES:

- 1) THIS APPLIANCE MAY BE INSTALLED ON COMBUSTIBLE FLOORING
- 2) MINIMUM CLEARANCES TO ADJACENT CONSTRUCTION ARE AS FOLLOWS:
 LEFT & RIGHT SIDES: 24"
 FRONT: 24"
 REAR: 24"
 CEILING HIEGHT: 100"

- NOTE:
1. ALL DIMENSIONS SHOWN ARE IN INCHES (CENTIMETERS).
 2. THE ZERO SIDE CLEARANCE OPTION CAN ONLY BE EMPLOYED IN TWO UNIT SETS. DOOR PANEL REMOVAL NOT REQUIRED FOR ZERO SIDE CLEARANCE.
 3. WHEN USING THE AERCO CONDENSATE NEUTRALIZER TANK, FOR PROPER CONDENSATE DRAINAGE, THE NEUTRALIZER TANK MUST BE INSTALLED IN A PIT OR THE BOILER AND THE AERCO CONDENSATE TRAP MUST BE ELEVATED 4" OR HIGHER ABOVE THE FLOOR. SEE CONDENSATE TANK INSTRUCTIONS TID-0074 FOR DETAILS.
 4. SECONDARY INLET ONLY AVAILABLE ON BENCHMARK® PLATINUM SERIES UNITS.
 5. CLEARANCE DIMENSIONS ARE MINIMUMS RECOMMENDED BY AERCO. LOCAL CODES AND AUTHORITIES SHOULD BE CONSULTED.

AERCO RESERVES THE RIGHT TO MODIFY BOILER DIMENSIONS WITHOUT PRIOR NOTICE

		100 ORITANI DRIVE BLAUVELT, NY 10913 aerco.com
BENCHMARK 2500 & 3000 MBH GAS FIRED BOILER ZERO SIDE CLEARANCE DRAWING		
DWN. BY _____ PDR. DATE 021512 SCALE _____ APPD. _____ DATE _____	SD-A-898	REV E