


Application Design Guide

Benchmark[®] NX Boilers with Edge X Controller

Models 399 and 500

Other documents for this product include:

OMM-0183 BMK NX Installation & Operation Manual
OMM-0170 Edge X Controller Manual
OMM-0184 BMK NX 399-500 Edge Reference Manual
TAG-0119 Benchmark NX Gas Guide
TAG-0120 Benchmark NX Electrical Power Guide
TAG-0121 Benchmark NX Piping Guide
TAG-0122 Benchmark NX Venting and Combustion Air Design Guide

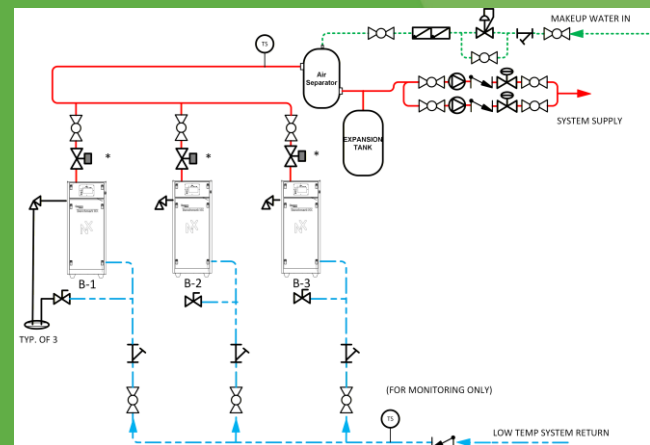

Disclaimer

The information contained in this document is subject to change without notice from AERCO International, Inc. AERCO makes no warranty of any kind with respect to this material, including, but not limited to, implied warranties of merchantability and fitness for a particular application. Some states do not allow the exclusion or limitation of incidental or consequential damages, so the above limitation may not apply. AERCO International is not liable for errors appearing in this document, not for incidental or consequential damages occurring in connection with the furnishing, performance, or use of these materials.




Table of Contents

1. GENERAL..... 3

2. SINGLE AND MULTIPLE APPLICATIONS 3

3. PIPING..... 3

 3.1 Pressure and Temperature Ratings 3

 3.2 Flow Rate Specifications..... 3

 3.3 Pipe Design Provisions 3

4. TYPICAL APPLICATIONS 4

 4.1 Space Heating 4

5. INPUT/OUTPUT REFERENCE DIAGRAM 7

1. GENERAL

AERCO Benchmark NX (BMK NX) condensing boilers optimize hydronic system for peak performance and efficiency. They operate with high turndown to match the changing requirements of the energy input, minimize cycling and maximize seasonal efficiency. Their compact footprint allows flexibility and reduce total project installation costs. This guide helps designers apply the BMK NX boilers to the most common types of systems. If a special application is needed, please call your local AERCO Representative or the AERCO factory for specific application information.

Installation, wiring, startup, and service must be performed by qualified personnel in accordance with applicable electrical, mechanical, and building codes.

2. SINGLE AND MULTIPLE APPLICATIONS

Benchmark NX boilers can be used as stand-alone single units or in multiple batteries of up to 16 units. Actual boiler sizing and selection are the responsibility of the designer. ASHRAE standards recommend sizing equipment with minimum of oversizing for maximum efficiency.

3. PIPING

3.1 Pressure and Temperature Ratings

The maximum allowable working pressure (MAWP) for BMK NX boilers is 160 psig (1103 kPa).

Individual ASME pressure relief valves are supplied on each boiler in setpoints of 30, 50, 60, 75, 100, 125, 150, or 160 psig (207, 414, 517, 689, 862, 1034, or 1103 kPa), as specified.

BMK NX units are applicable to systems with temperatures of 50 °F to 190 °F (10 °C to 88 °C). Due to their condensing design, normal low temperature restrictions do not apply. While most heating applications are designed with a 20 °F (11 °C) temperature drop, BMK NX boilers are capable of 50 °F (28 °C) temperature drop through the heat exchanger without thermal stress.

3.2 Flow Rate Specifications

AERCO BMK NX boilers require the following minimum flow rate per boiler for proper and stable boiler temperature control operation. To prevent erosion of construction materials, maximum flow per boiler are limited as shown below.

BMK NX Model	Minimum Flow Rate	Maximum Flow Rate
BMK NX 399	19 gpm (72 lpm)	75 gpm (284 lpm)
BMK NX 500	23 gpm (87 lpm)	91 gpm (344 lpm)

3.3 Pipe Design Provisions

Maximum and minimum flow must be observed in piping design. Ancillary flow devices must provide minimum flow. Controls (internal boiler controls and/or building automation system) must be configured to operate pumps and valves to allow flow through BMK NX boilers in operation.

For multiple boiler installations, the piping must be designed to ensure balanced flow through all boilers by using reverse-return piping or a balancing valve at the outlet of each boiler. Failure to balance flow evenly through the boilers will prevent full delivery of boiler capability at design conditions and may cause over-cycling and unnecessary stress on the boilers.

The BMK NX boiler is approved for zero-side clearance in two-unit pairs where space is at a premium. Piping should allow free access between boilers. For maintenance purposes, each BMK NX boiler shall have individual manual valves on supply and return from the system.

When used with a refrigeration (chiller) system, the boilers must be installed to prevent the chilled medium from entering the boiler.

4. TYPICAL APPLICATIONS

BMK NX boilers can be used in any closed-loop heating system within their design limitations. The following typical piping and wiring schematic diagrams represent the most common types of installation detail. These diagrams are not intended for any particular system but are rather composites of how AERCO boilers interface with heating applications in the real world. The designer should incorporate BMK NX boilers in each system so as to achieve maximum operating efficiency. With ultimate control over the energy transfer process under a broad range of temperatures, the designer should first consider how the system best needs the supplied energy. The boilers should then be applied in the manner that best enables them to use their finite control and capability to supplement the system, using minimum applied energy.

The following examples illustrate typical piping and wiring diagrams with brief description of the application and its features:

IMPORTANT!

For all applications, the header sensor (S-1) must be located 2-10 ft from the nearest boiler.

- Diagram 4-1 – Space Heating

NOTE: For essential system setting parameters see the Edge X Controller Manual, OMM-0170.

See Section 5 for complete Input/Output Reference diagram.

Concept Drawings: The following illustrations are concept drawings only. They are not intended to describe a complete system, nor any particular system. It is up to the system designer to determine the necessary components for and configuration of the particular system being designed, including ancillary mechanical and control components, and any safety devices that are appropriate in the designer's judgement, in order to properly size, configure and design that system and to ensure compliance with building and safety code requirements.


4.1 Space Heating

Application Description & Features: Benchmark NX boilers are operated via Boiler Sequencing Technology (BST) to provide space heating. Supply temperature is maintained via constant setpoint, outdoor air reset or remote setpoint command (from building automation system or remote analog signal). Application utilizes optional header sensor, sequencing valves and outdoor air sensor (available from AERCO); return header sensor is optional. Alternatively, instead of controlling to a header temperature, since described application is primary-variable, an average outlet temperature of available unit shall be considered to determine demand.

- The AERCO Edge X controller sequences the boiler plant for maximum system efficiency by running as many boilers as available, each operating at its most efficient firing rate.
- Sequencing valves isolate standby boilers, reducing minimum flow requirement.
- The Edge X controller supports integration with BAS via BACnet MSTP, and BACnet IP.
- For other communication protocols such as Modbus RTU, Modbus TCP or Lonworks, consult your AERCO Sales Representative.

Essential System Settings:

Parameter	Setting
Cascade Mode	Toggle ON
Operating Mode	Constant Setpoint, Outdoor Air Reset or Remote Setpoint
System HDR Temp Sensor	Direct or BAS
Outside Air Temp Sensor Source (If Operating Mode = Outdoor Air Reset)	Direct or BAS
Isolation Valve RLY Ctrl Function	Isolation Valve RLY Ctrl
Isolation Valve Feedback	Toggle ON

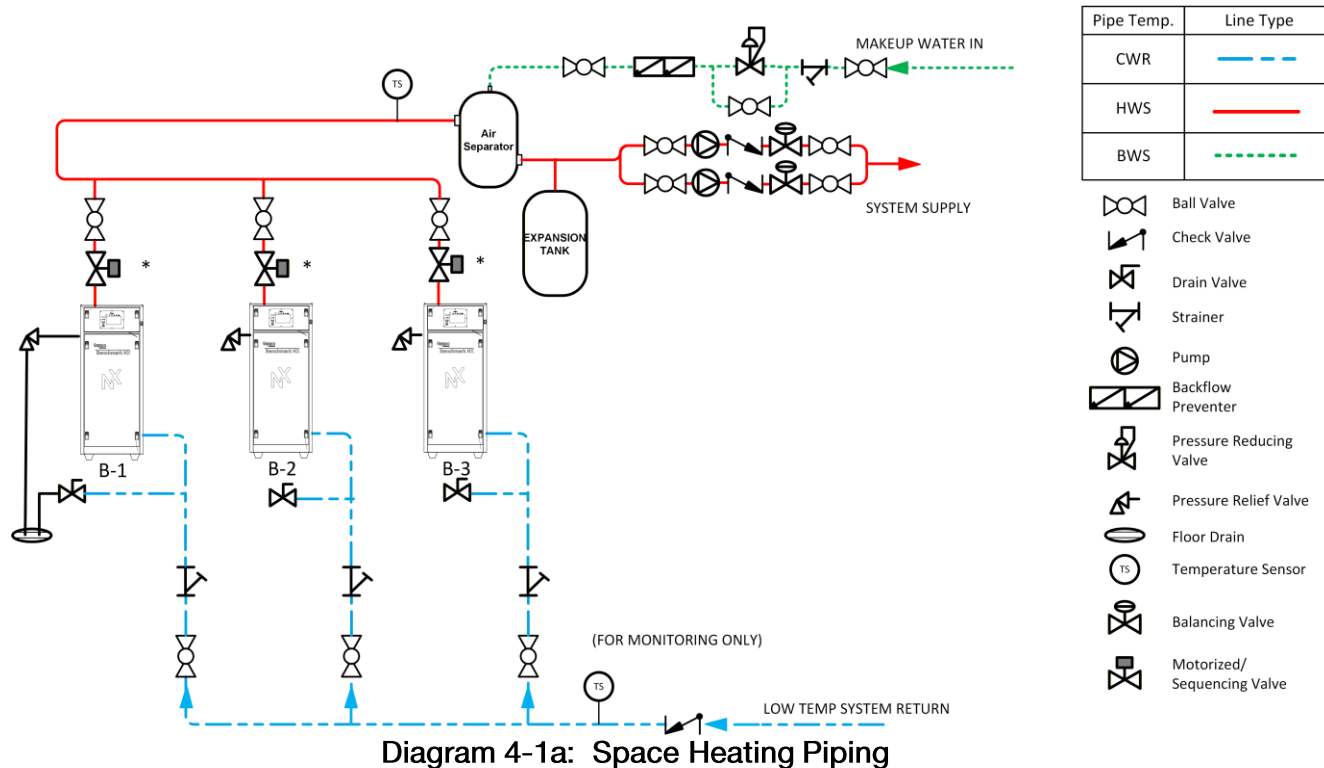

WARNING: Hazardous voltage can cause severe injury, death, or property damage.

- Disconnect all electrical power before installing, servicing, or maintaining boiler.
- Lockout and tagout all power sources before performing work.
- Verify power is disconnected before touching electrical components.

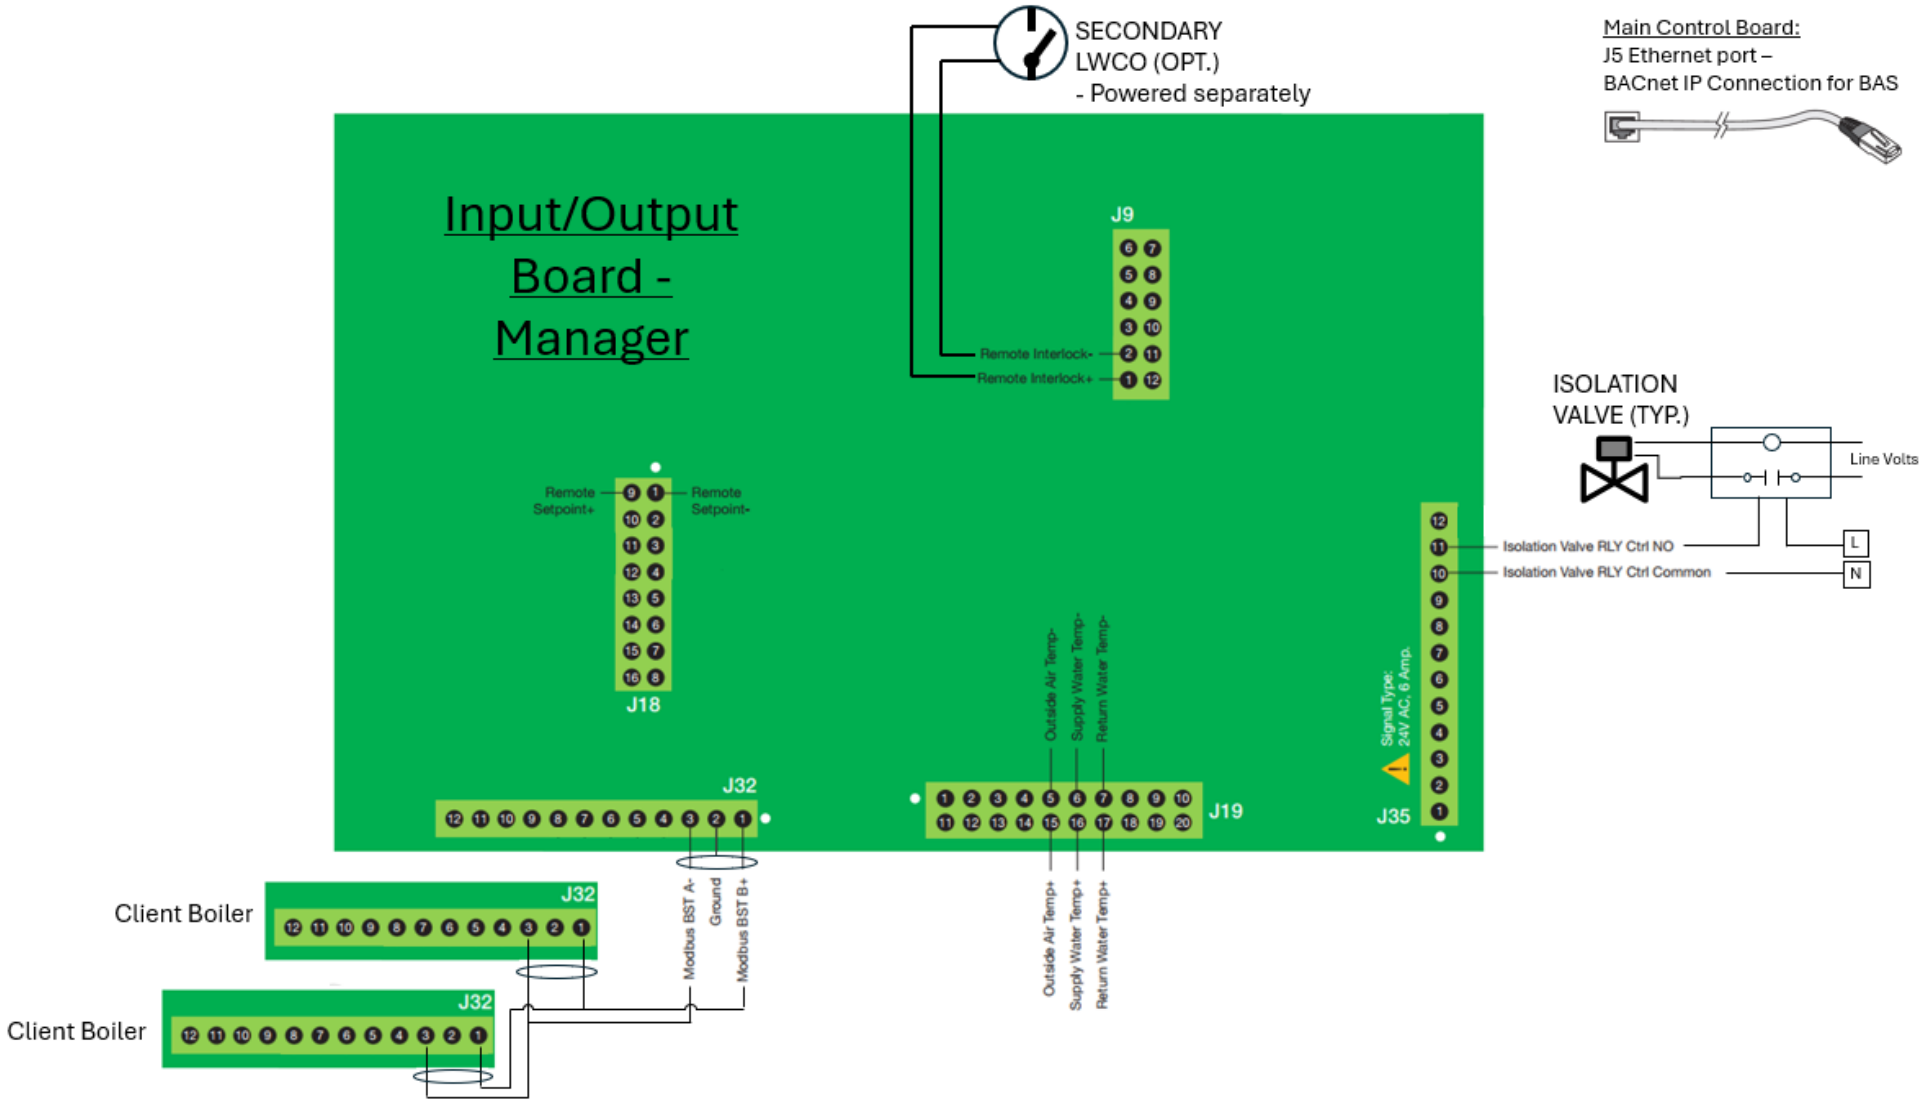


Diagram 4-1b: Space Heating Wiring


5. INPUT/OUTPUT REFERENCE DIAGRAM

Wiring connections for temperature sensors, control signals, interlocks and auxiliary equipment are made on the Input/Output board. See Benchmark NX Operation and Maintenance Manual, OMM-0183 for details.

The following relays are rated 24VAC, 6A:

- Aux Relay
- Fault Relay
- Isolation Valve Relay / Primary Pump Control
- Reserve Unit Relay

Individual Boiler Remote Interlock:
Terminal 1 and 2 of J9, wire with a separate dry contact from a multi-pole switch only.

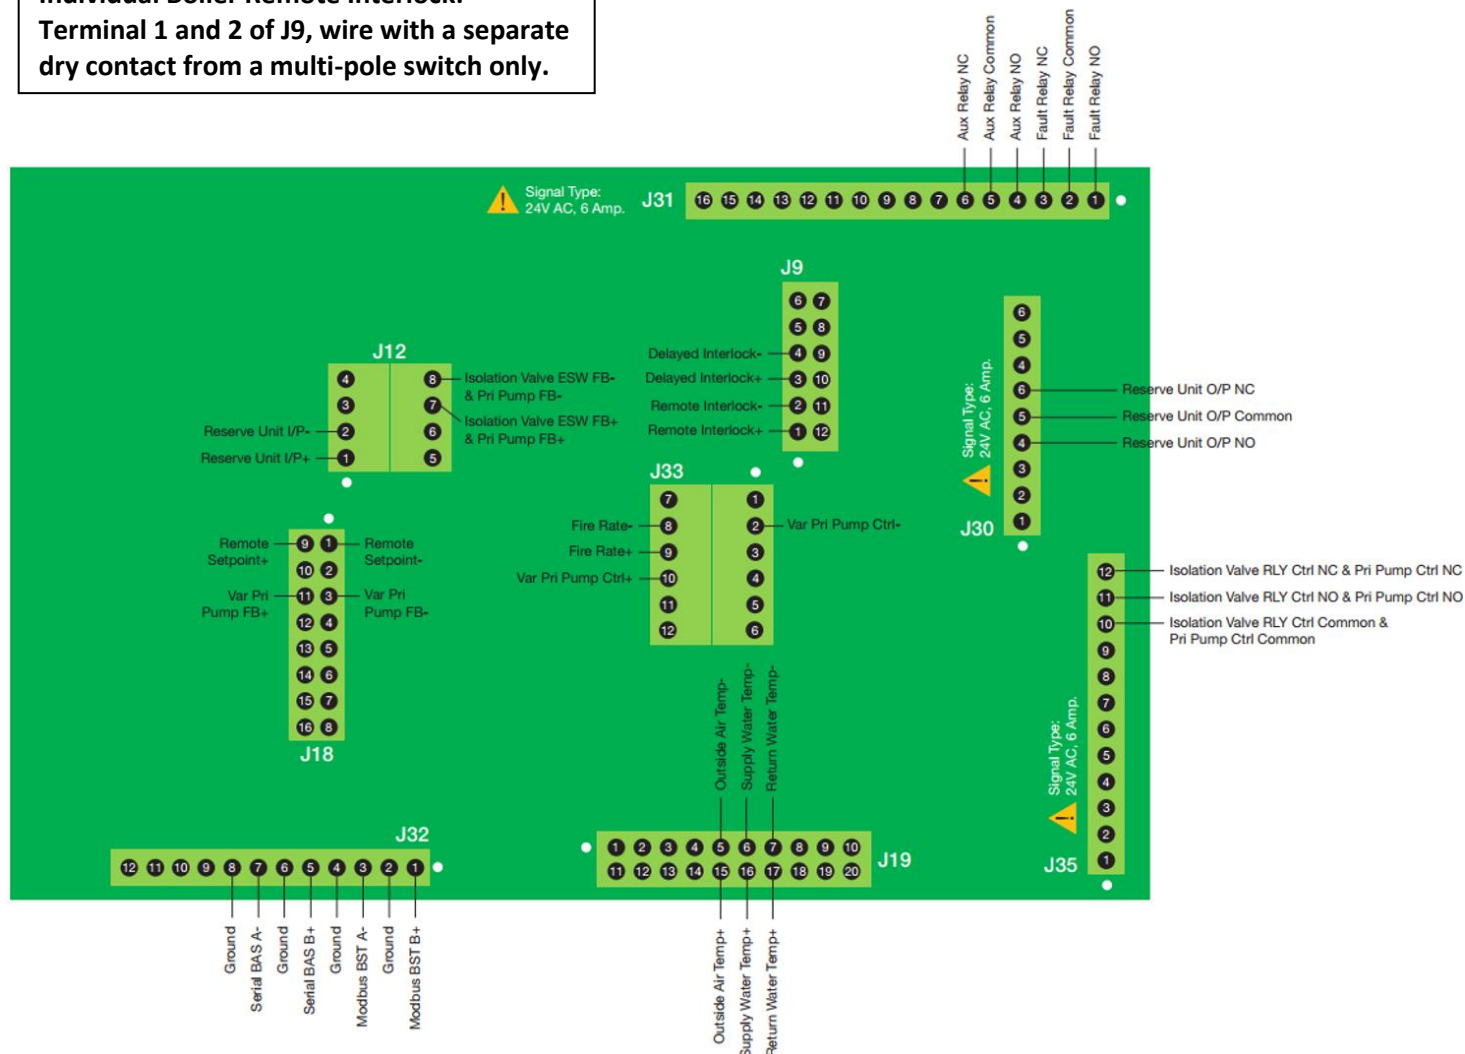



© AERCO International, Inc., 2026