




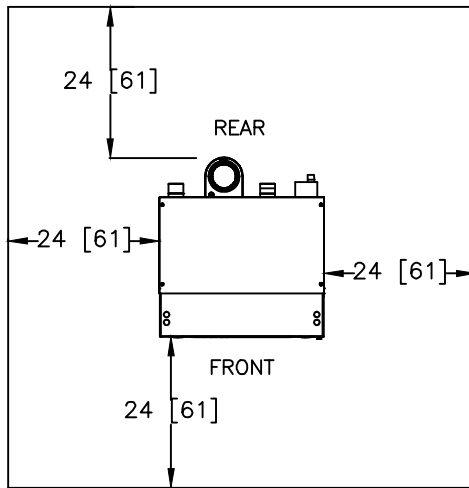

SINGLE UNIT

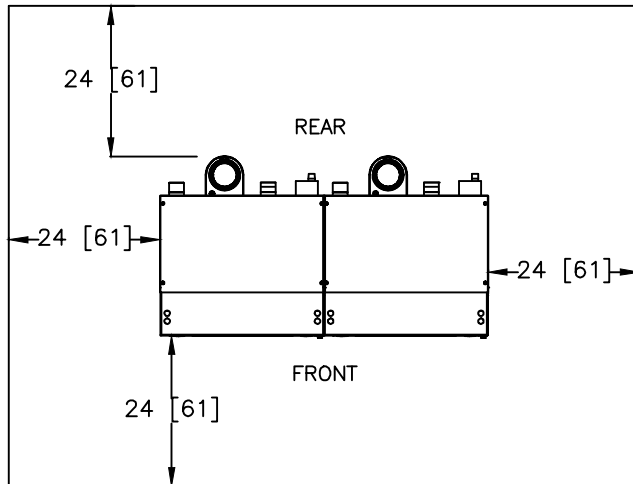

MINIMAL SIDE  
CLEARANCE UNITS

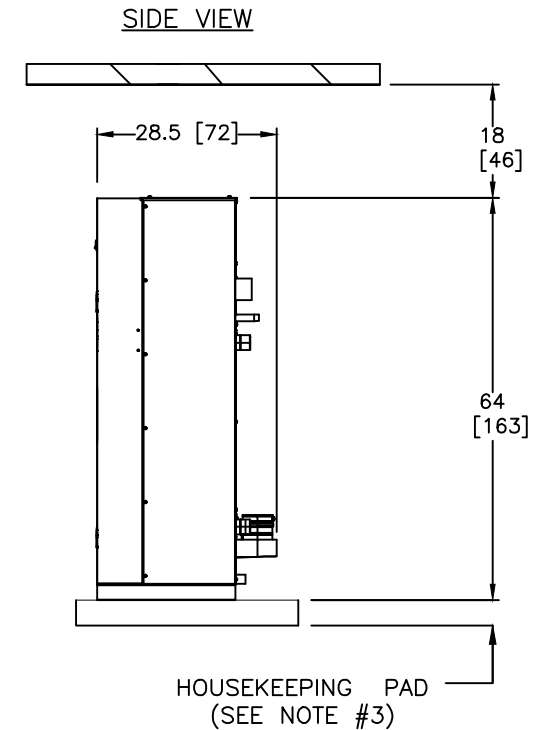

**NOTES:**

1. ALL DIMENSIONS SHOWN ARE IN INCHES [CENTIMETERS].
2. THE 24"[61] FRONT CLEARANCE REQUIRED PER NEC. ALL OTHER CLEARANCE DIMENSIONS ARE MINIMUMS RECOMMENDED BY AERCO. LOCAL CODES AND AUTHORITIES SHOULD BE CONSULTED.
3. BOILER MUST BE INSTALLED ON A FLAT, LEVEL SURFACE.
4. THE ZERO SIDE CLEARANCE OPTION CAN ONLY BE EMPLOYED IN TWO UNIT SETS.



100 ORITANI DRIVE BLAUVELT, NY 10913  
aerco.com

BENCHMARK NX 399-500 MBH  
SINGLE & MINIMAL SIDE CLEARANCE UNITS  
DIMENSIONAL DRAWING

DWN.BY K.S. DATE 011226  
SCALE NTS  
REV.BY \_\_\_\_\_ DATE \_\_\_\_\_

SD-A-1427

REV.  
A